

Table A6-7
Inner Pipig for Impeller Casing Consumables

NOTE
 •Remark ※ : Parts to be replaced at each regular inspection.
 •Not Remark ※ : Replace with a new one depending on the condition.
 •"Order Q'ty" shows parts quantity for two fans.
 •(Quantity required normal maintenance.)

EQUIPMENT No.	MARKS	DESCRIPTION	PART NO	1-PIECE WEIGHT (kg)	REMARK	ORDER Q'TY	DELIVERY TIME (Month)	REPLACEMENT SCHEDULE (Year)
(G) I N N E R P I P I G F O R I M P E L L E R C A S I N G	1_1	SUPPLY OIL PIPE 10A × S8 (FOR A)	FIG-7-1_1	1.12		1		
	1_2	SUPPLY OIL PIPE 10A × S8 (FOR B)	FIG-7-1_2	2.24		1		
	2_1	SUPPLY OIL PIPE 15A × S8 (FOR A)	FIG-7-2_1	1.83		1		
	2_2	SUPPLY OIL PIPE 15A × S8 (FOR B)	FIG-7-2_2	3.40		1		
	3_1	SUPPLY OIL PIPE 25A × S8 (FOR A)	FIG-7-3_1	7.45		1		
	3_2	SUPPLY OIL PIPE 25A × S8 (FOR B)	FIG-7-3_2	7.28		1		
	4	GAS VENT PIPE 20A × S4	FIG-7-④	1.67		2		
	5	BRG. DRAIN PIPE 25A × S4	FIG-7-⑤	1.81		2		
	6	RETURN OIL PIPE 65A × S4	FIG-7-⑥	6.91		2		
	7	S-90E 10 × S8	FIG-7-⑦	0.15		4		
	8_1	S-90E 15 × S8 (FOR A)	FIG-7-8_1	0.25		2		
	8_2	S-90E 15 × S8 (FOR B)	FIG-7-8_2	0.25		4		
	9	S-90E 20 × S8	FIG-7-⑨	0.48		2		
	10	S-90E 25 × S8	FIG-7-⑩	0.54		4		
	11	S-45E 20 × S8	FIG-7-⑪	0.30		2		
	12	S-45E 25 × S8	FIG-7-⑫	0.44		4		
	13	S-ST 25 × S8	FIG-7-⑬	0.80		6		
	14	S-R 25 × 10 × S8	FIG-7-⑭	0.32		4		
	15	S-R 25 × 15 × S8	FIG-7-⑮	0.398		4		
	16	B-90ES 65 × S4	FIG-7-⑯	0.91		4		
	17	FLANGE #150-20	FIG-7-⑰	0.57		2		
	18	FLANGE #150-25	FIG-7-⑱	0.78		4		
	19	FLANGE #150-65	FIG-7-⑲	3.25		2		
	20	FLANGE 10K-20	FIG-7-⑳	0.73		2		
	21	FLANGE 10K-25	FIG-7-㉑	1.13		2		
	22	FLANGE 10K-65	FIG-7-㉒	2.60		2		
	23	FLANGE	FIG-7-㉓	0.12		4		
	24	FLANGE	FIG-7-㉔	0.22		4		
	25	BLIND FLANGE 10K-25	FIG-7-㉕	1.22		2		
	26	BLIND FLANGE 10K-65	FIG-7-㉖	3.24		2		
	27	GASKET #150-20	FIG-7-㉗	0.005	※	2	4	every 4years or during fan overhaul
	28	GASKET #150-25	FIG-7-㉘	0.007	※	4	4	every 4years or during fan overhaul
	29	GASKET #150-65	FIG-7-㉙	0.020	※	2	4	every 4years or during fan overhaul
	30	GASKET 10K-20	FIG-7-㉚	0.007	※	2	4	every 4years or during fan overhaul
	31	GASKET 10K-25	FIG-7-㉛	0.009	※	4	4	every 4years or during fan overhaul
	32	GASKET 10K-65	FIG-7-㉜	0.020	※	4	4	every 4years or during fan overhaul
33	GASKET	FIG-7-㉝	0.001	※	4	4	every 4years or during fan overhaul	
34	GASKET	FIG-7-㉞	0.002	※	4	4	every 4years or during fan overhaul	
35	BOLT M12 × 35	FIG-7-㉟	0.050		8			
36	BOLT M14 × 50	FIG-7-㊱	0.090		8			

CONFIDENTIAL
 THIS DOCUMENT IS THE PROPERTY OF MITSUBISHI HITACHI POWER SYSTEMS, LTD.(MHPS) AND CONFIDENTIAL IT MUST NEITHER BE COPIED NOR USED FOR ANY PURPOSE OR MANNER OTHER THAN EXPRESSLY PERMITTED BY MHPS OR WITH A PRIOR WRITTEN CONSENT OF MHPS NEITHER IS IT TO BE HANDED OVER NOR COMMUNICATED TO A THIRD PARTY IN ANY WAY. BREACH OR INFRINGEMENT OF ANY KIND WILL LEAD TO LEGAL ACTION.

CONFIDENTIAL
 THIS DOCUMENT IS THE PROPERTY OF MITSUBISHI HITACHI POWER SYSTEMS, LTD. (MHPS) AND CONFIDENTIAL. IT MUST NEITHER BE COPIED NOR USED FOR ANY PURPOSE OR MANNER OTHER THAN EXPRESSLY PERMITTED BY MHPS OR WITH A PRIOR WRITTEN CONSENT OF MHPS. NEITHER IS IT TO BE HANDED OVER NOR COMMUNICATED TO A THIRD PARTY IN ANY WAY. BREACH OR INFRAINGEMENT OF ANY KIND WILL LEAD TO LEGAL ACTION.

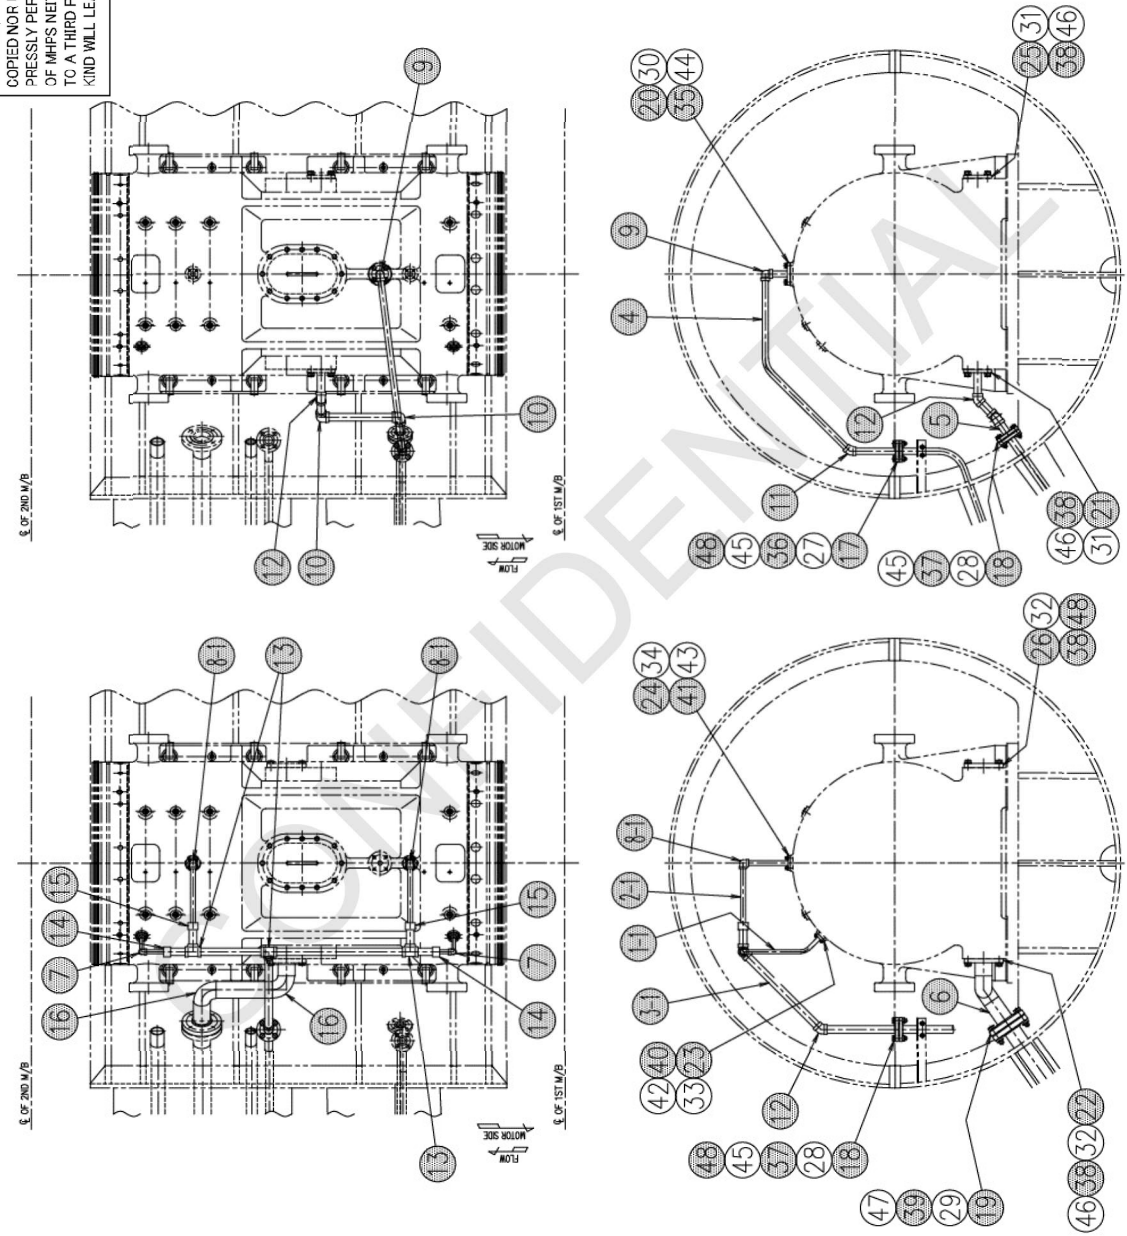


FIG-7-1

A F A N

CONSUMABLE PARTS LIST
(INNER PIPING FOR IMPELLER CASING)

