

SPECIFICATION


POWER SOURCE

PIPING PORT

POWER CIRCUIT : AC380V 50Hzx3φ
 CONTROL CIRCUIT : DC24V
 ELECTRIC MOTOR : 7.5KW 6P,3φ x2
 HYDRAULIC PUMP : 34.5L/min, 69bar (6.9MPa)
 HYDRAULIC OPERATING FLUID : ISO VG32
 PIPELINE MATERIAL : STPG370,SUS304TP

P : ANSI 150LB 1B FLANGE(SUS)
 T : ANSI 150LB 1-1/2B FLANGE
 LUBE.PORT: ANSI 150LB 1B FLANGE(SUS)
 LEAK: ANSI 150LB 3/4B FLANGE
 RETURN PORT: ANSI 150LB 2-1/2B FLANGE
 SPARE PORT: ANSI 150LB 2B FLANGE
 COOLING WATER
 WI,WO: ANSI 150LB 2B FLANGE

PAF UNIT5 A.B 2SET
 UNIT6 A.B 2SET

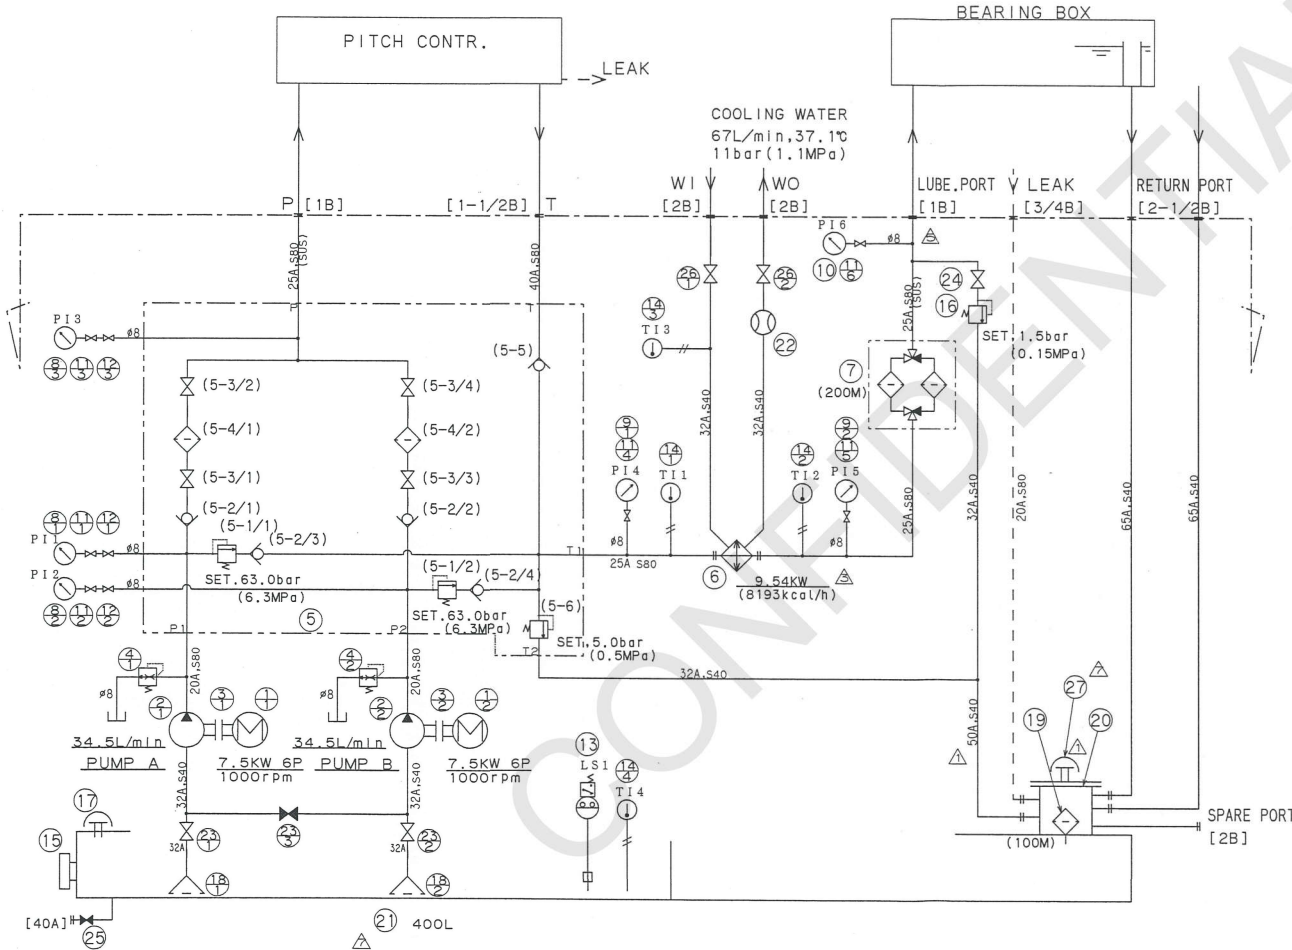

27	AIR BREATHER	AP-16	1	TAISEI
26	GATE VALVE	T20KFS1 20K-32A	2	HITACHI
25	GATE VALVE	T10KFS1 10K-40A	1	//
24	GATE VALVE	T10KFS1 10K-32A	1	//
23	GATE VALVE	T10KFS1 10K-32A	3	HITACHI
22	FLOW SIGHT	GFDF-20-SC-PH 20K-32A	1	WASHINO
21	OIL TANK	400L	1	CSK
20	RETURN COLLECTING PIPE	300A.SGPX400L	1	CSK
19	SUS ELEMENT	100 MESH	1	CSK
18	SUCTION STRAINER	SFT-12-150W	2	TAISEI
17	WITH SUPPLY PORT	MSA-C50T-P	1	MASUDA
16	PRESS.REGULATING VALVE	S-KPA-P422 32A	1	SANKYO
15	OIL LEVEL GAUGE	KLM-400AV-M12	1	KYOWA
14	THERMOMETER	TL54-100-1XXX12A00111	4	NAGANO
13	LEVEL SWITCH	FR30B-1P	1	NOHKEN
12	GAUGE VALVE	GNT-04	3	HIROSE
11	GAUGE VALVE	FV10-492	6	NAGANO
10	PRESSURE GAUGE	GV42-243-4bar	1	NAGANO
9	PRESSURE GAUGE	GV42-243-10bar	2	//
8	PRESSURE GAUGE	GV42-243-150bar	3	NAGANO
7	DUPLEX FILTER	BCS-12-R-200W	1	TAISEI
6	OIL COOLER	HJ289-1.7-10.1	1	TAISEI
(-6)	RELIEF VALVE	HR-10104	1	△△
(-5)	CHECK VALVE	C20P-10-00	1	△
(-4)	LINE FILTER	GC-127-4-20U-RIV	2	
(-3)	STOP VALVE	HGD-4211-10J-23	4	
(-2)	CHECK VALVE	C10P-10-05	4	△
(-1)	RELIEF VALVE	HR-04139	2	△△
5	MANIFOLD ASS'Y	(SS400)	1	SET/CSK
4	AIR BLEED OFF VALVE	CAB-TO2-1-11	2	NACHI
3	FLEXIBLE FLANGED	FCL-160	2	NBK
2	VANE PUMP	PV2R2-41-L-RAA-41	2	YUKEN
1	ELECTRIC MOTOR	7.5KW 6P AC380V/50Hz,3φ	2	HYUNDAI

MARK	PART NAME	MODEL NO.	Q'TY	REMARK
				CUSTOMER MITSUBISHI HITACHI POWER SYSTEMS,LTD.
				NAME PRIMARY AIR FAN
APPROVED	CHECKED	DRAWN	CONTENTS	HYDRAULIC CIRCUIT DIAGRAM
				IM.000
PROJECT NO.	SERIAL NO.			PU6585A, PU6586A
DATE	REV.	DRAWING NO.		PU-6585A-00
DESIGNED BY	CHECKED BY			CHIKUYOU SEIKI
DATE	SPECIAL NOTE			KOGYO CO.,LTD

Uncontrolled when printed or downloaded. Verify that this is the correct version before reproduction. Reproduction of part or all the contents of the document is prohibited without written permission from SET. Shiki Jisaku Service